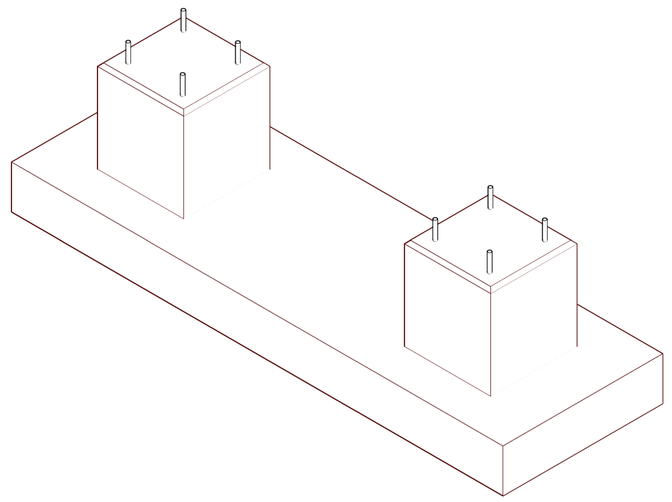

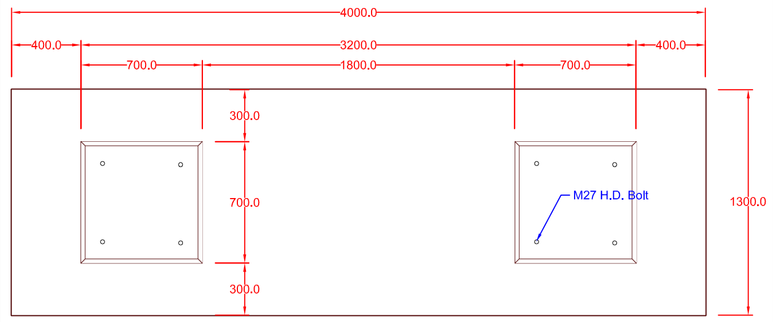

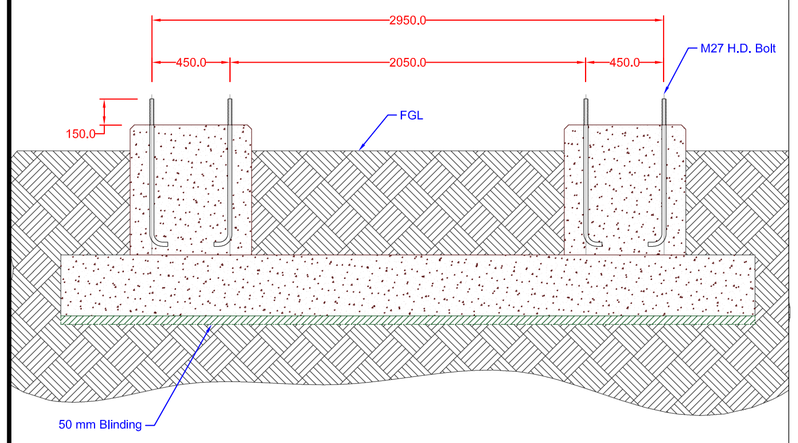

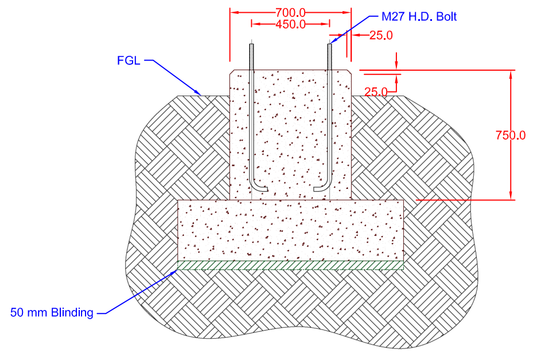

132 kV Circuit Breaker and DCB
eThekwini Electricity
Scale 1 : 25

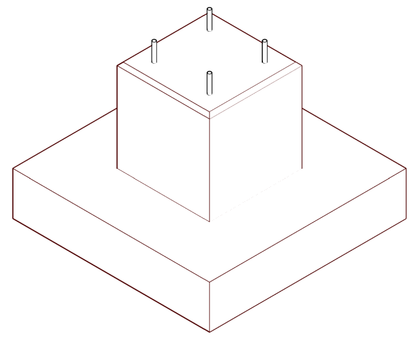

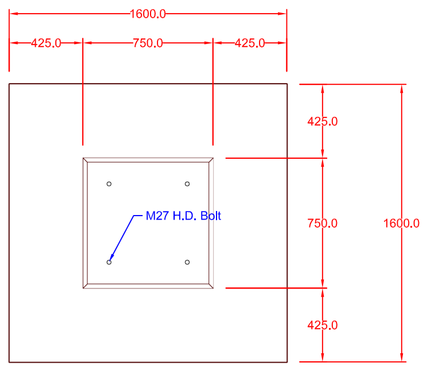

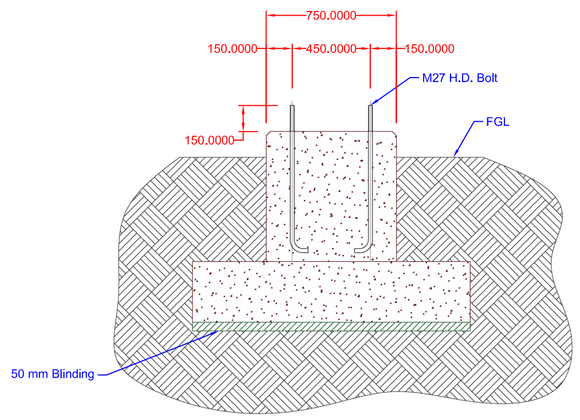

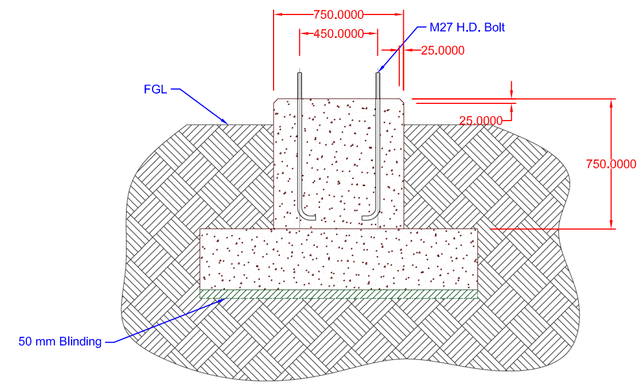

132 kV PI & CT & SA
eThekwini Electricity
Scale 1 : 25

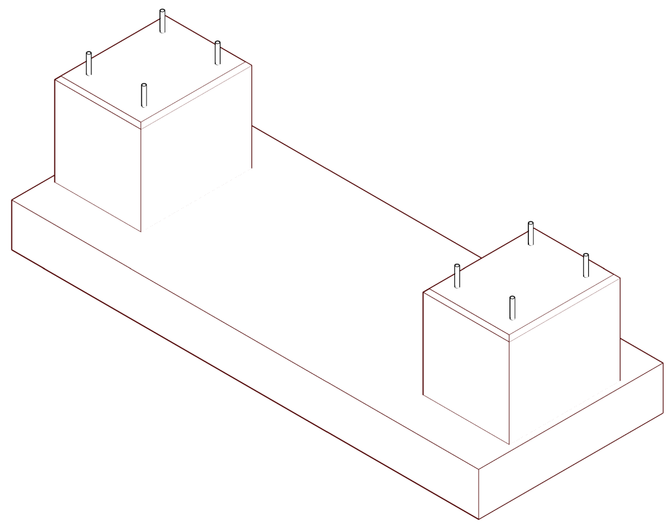

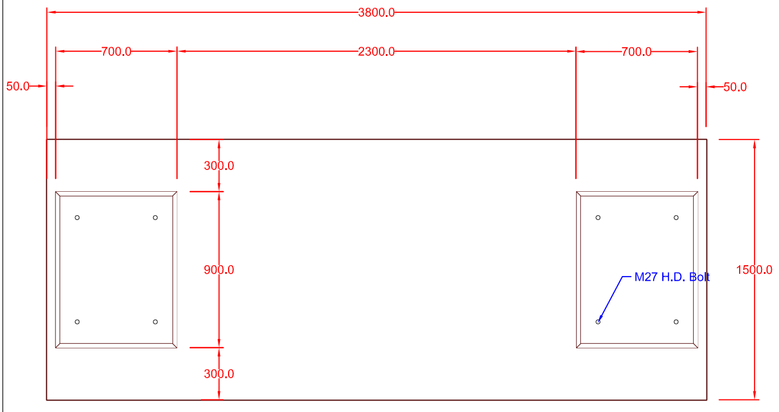

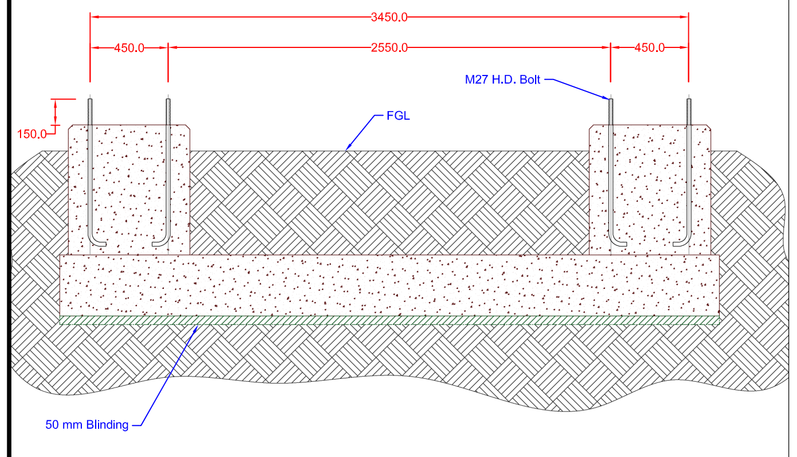

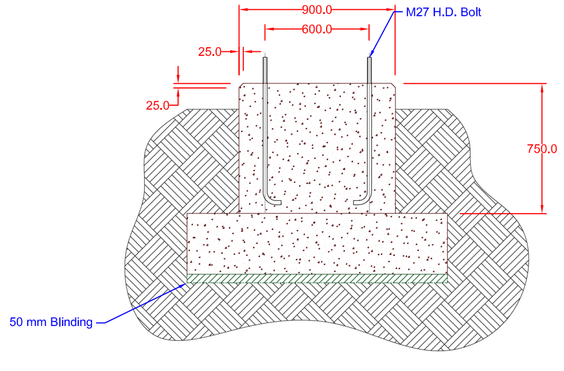

132 kV Isolator
eThekwini Electricity
Scale 1 : 25

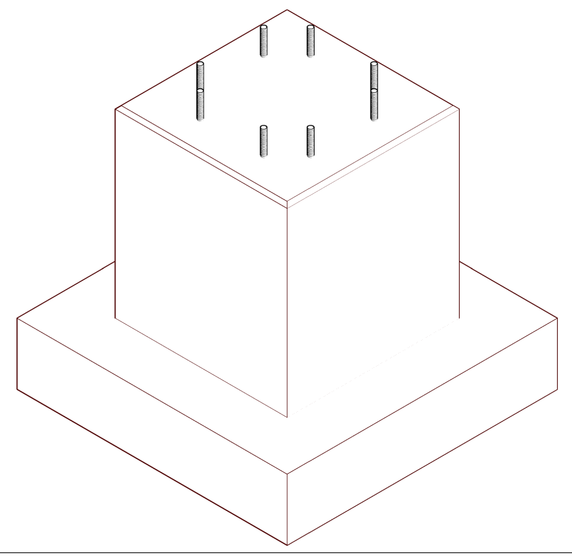

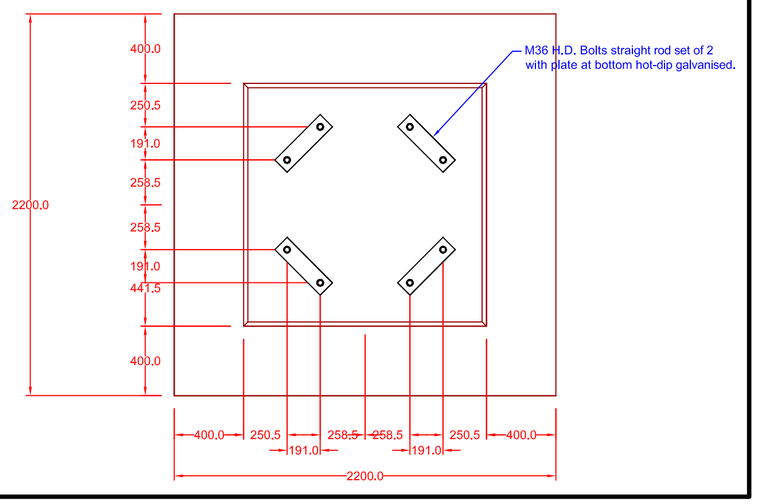

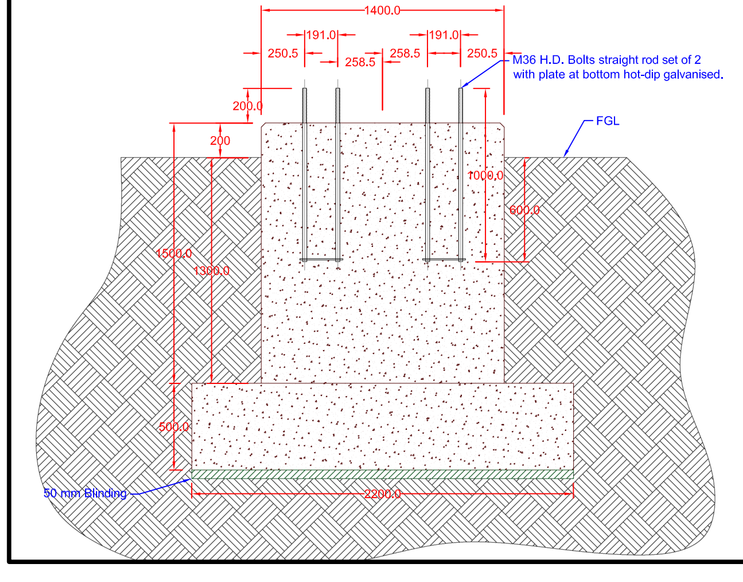

Notes :

1) Minumun bolt size shall be M27 ,Hevy duty hot dipped galvanized.
2) Rebar not shown, to be designed to Engineer's details.

	SIGNATURE	DATE
DRAWN	JRL	2024-01-31
CHIEF DRAUGHTPERSON		
PLANNING OFFICER		
PROTECTION ENGINEER		
PLANNING ENGINEER		
PROJECTS ENGINEER		
PLAN./PROJ. MANAGER		
APPROVED R.DHROCHAND DEPUTY HEAD: HV OPERATIONS		

1	ADDED STEEL GANTRY (STRUNG) BASE	M.R.	2024/01/31
REFERENCE DRAWINGS:	REVISIONS:	BY:	DATE:

ETHEKWINI ELECTRICITY

BASES TO BE STANDARDIZED FOR
eTHEKWINI ELECTRICITY

SCALE:	DRAWING NUMBER:	REV:
SEE LAYOUT	LCDD 2016002	1