ETHEKWINI ELECTRICITY
TYPICAL 132kV DOUBLE BUSBAR OUTDOOR SWITCHYARD LAYOUT

DRAWN	A.J.R.W.		
DATE	17/06/2015		

CHECD			
DRAUGHTSMAN			
PROTECTION			
OPERDIR			
ENGINEER			
PLANPROJ			
ENGINEER			
PLANPROJ			
MANAGER			

APPROVED
ELANEOUWD
DEPUTY HEAD, HV OPERATIONS

SCALE: 1 : 250

DRAWING NUMBER: TD 17
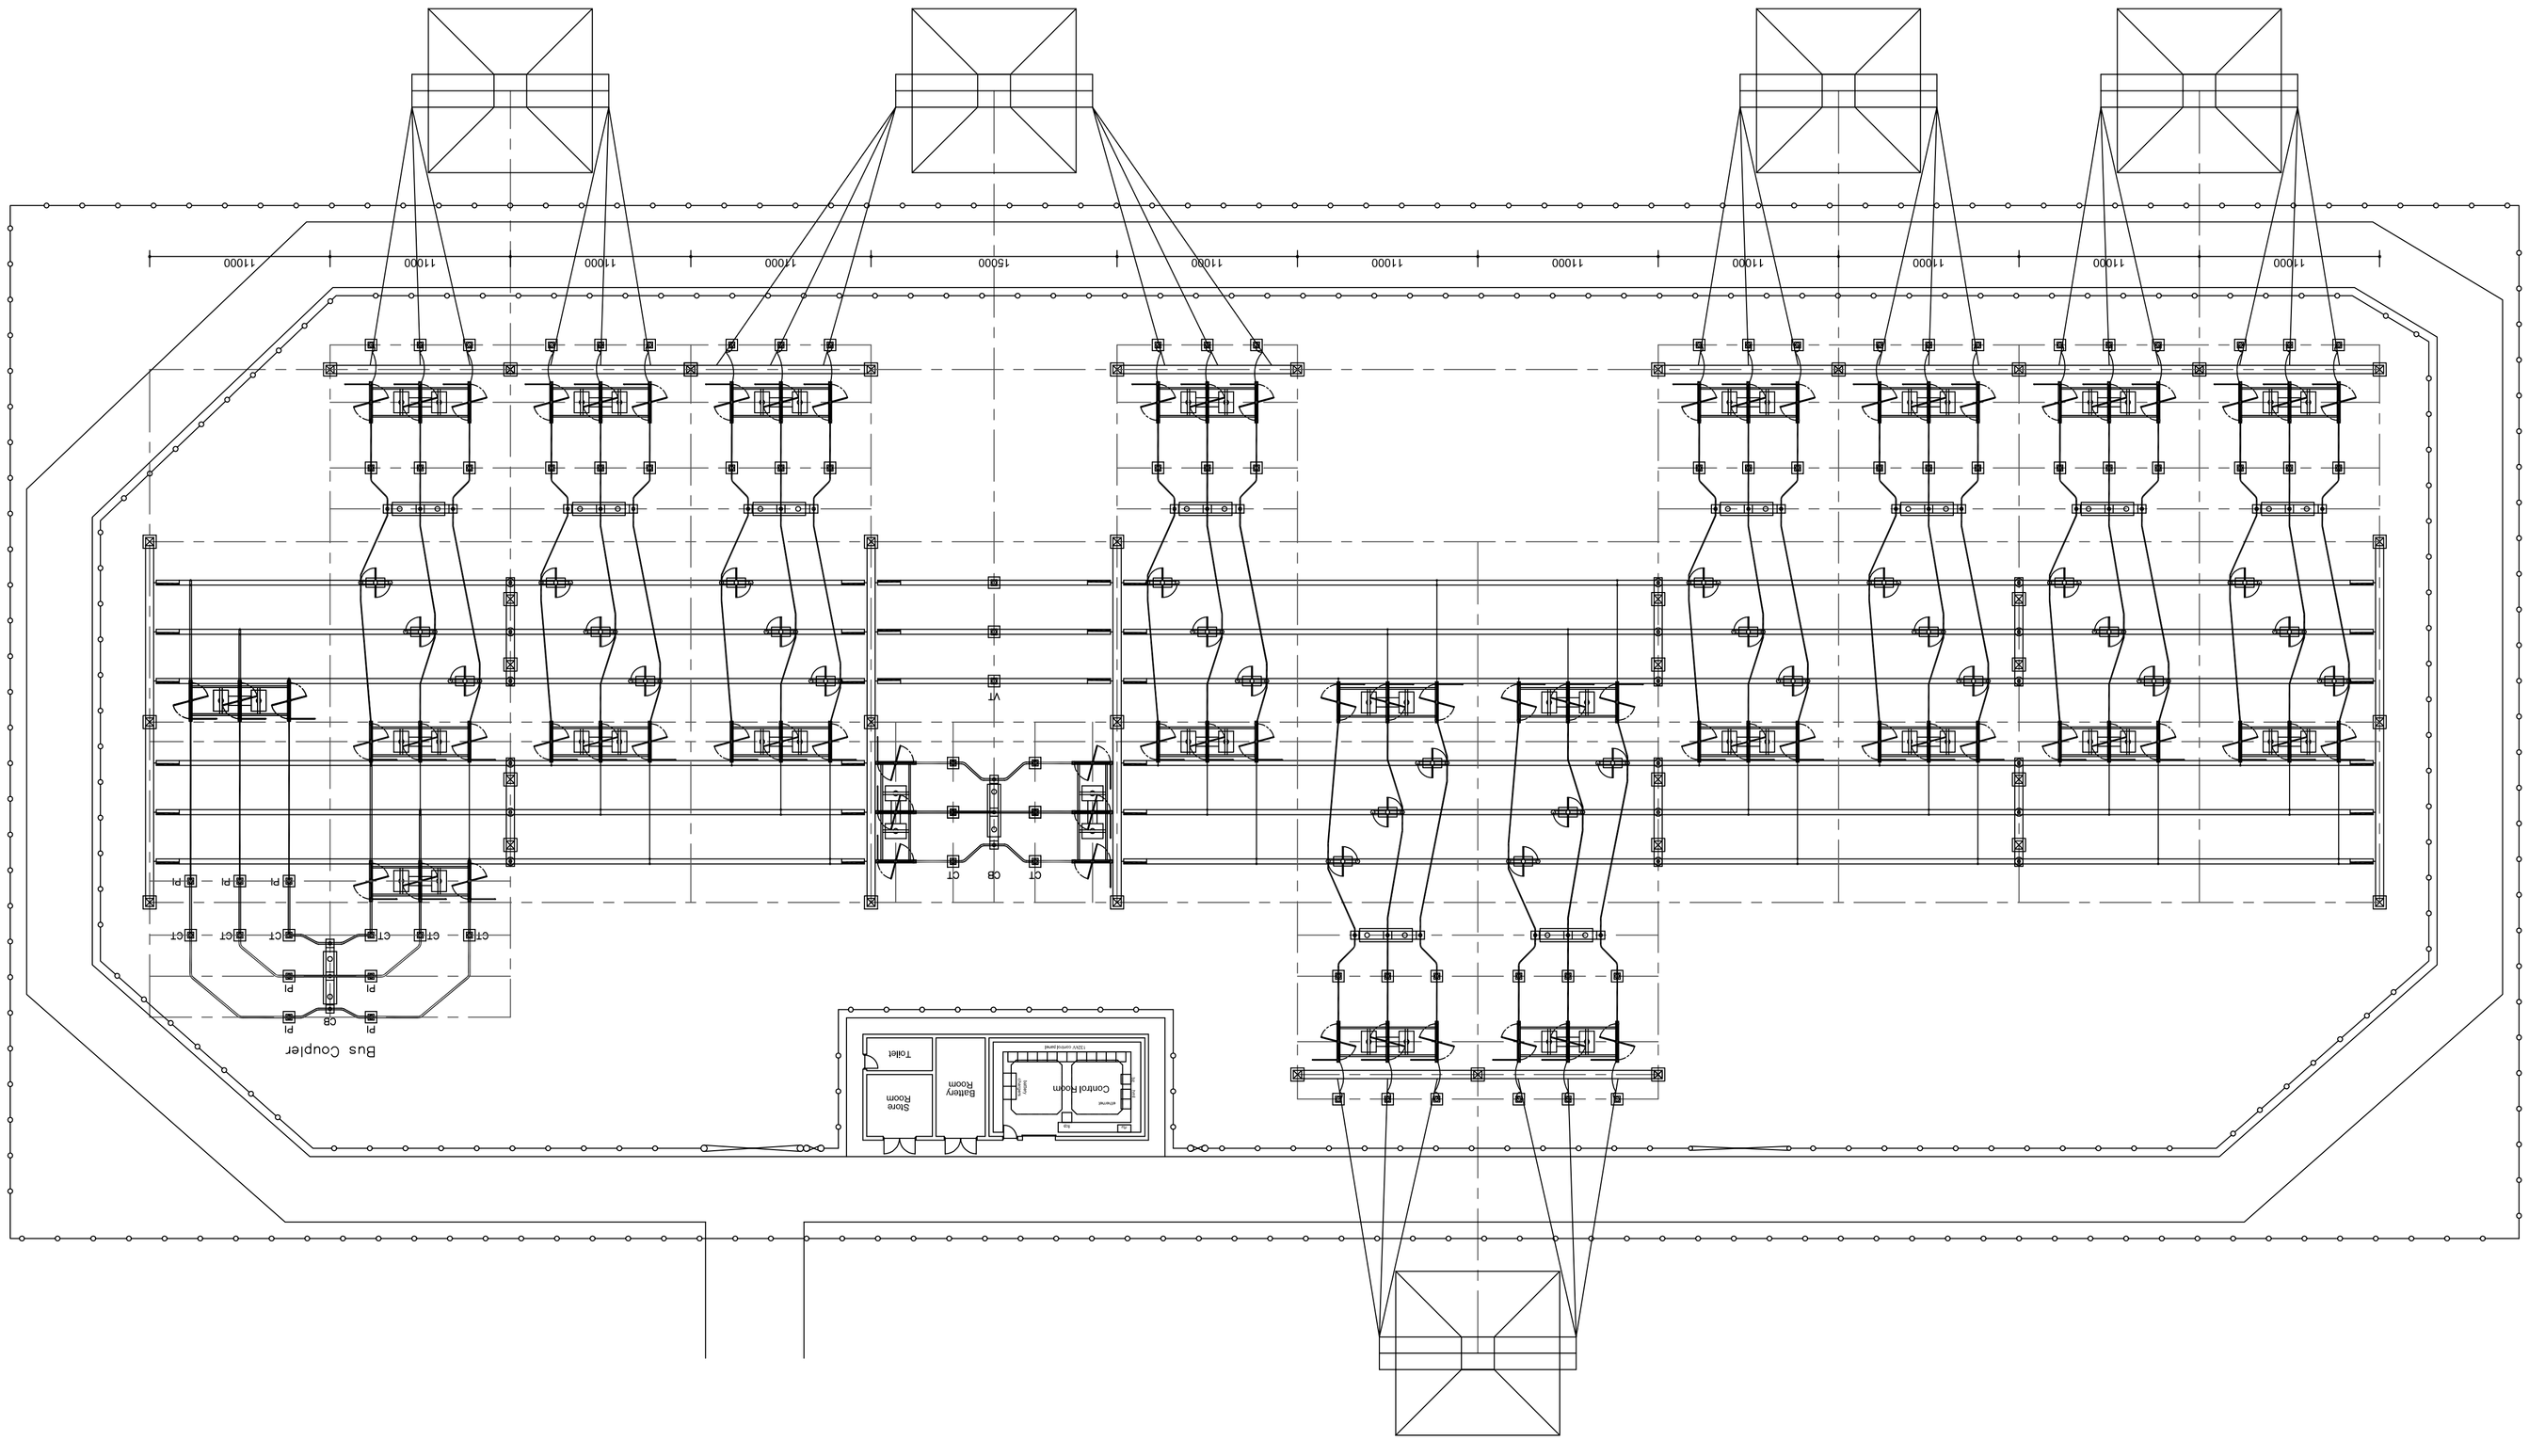
REV: